
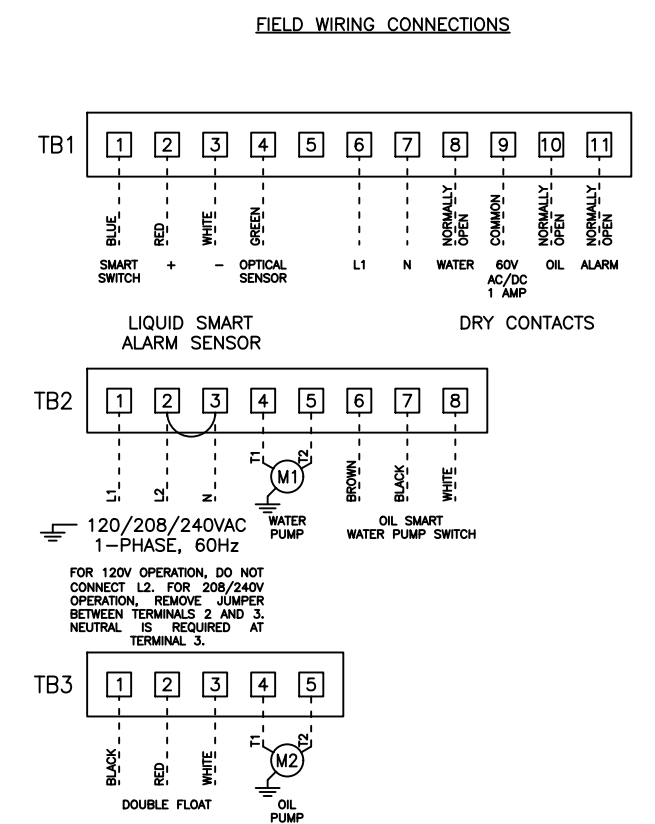
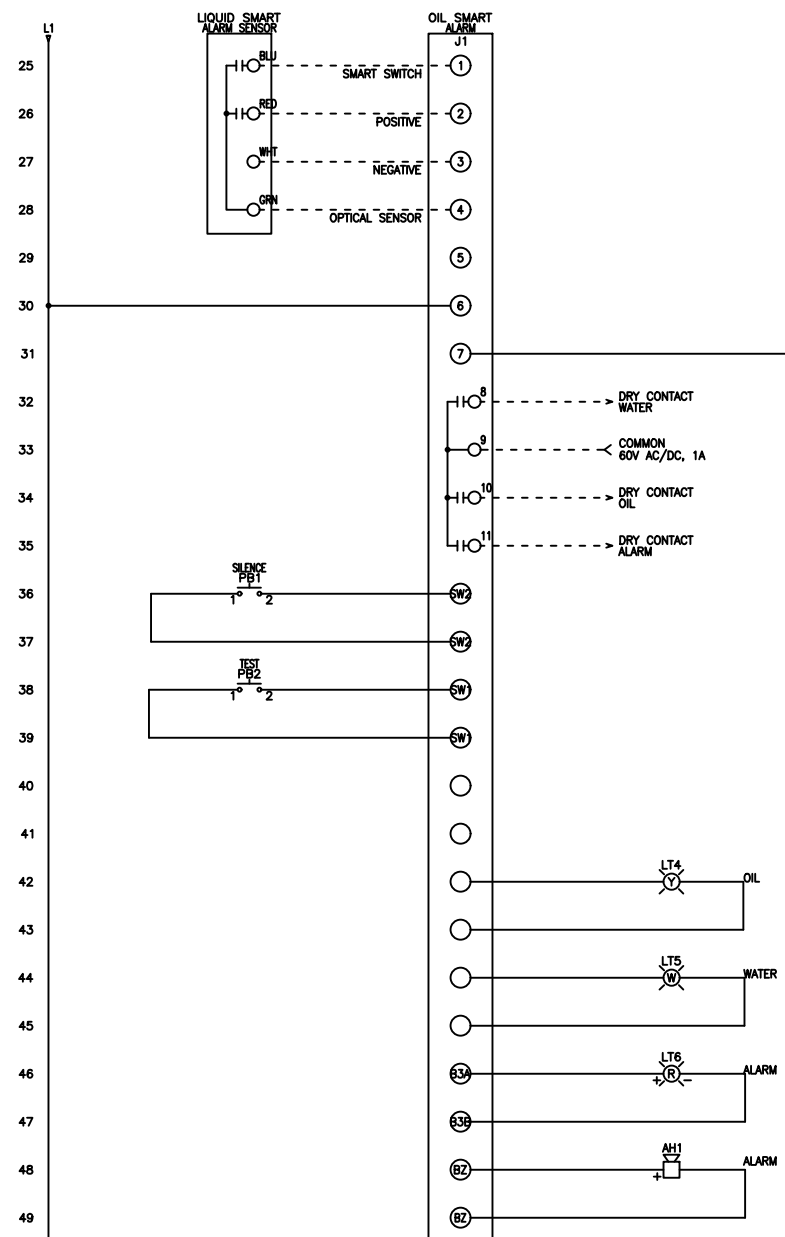


FRAME: OSSIM-30-OR-2

REVDATE: 0320

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	OIL SMART SWITCH & DUAL FLOAT SWITCH INCORPORATED INTO AUTO FUNCTION.	2/3/15	
	B	DUAL FLOAT SWITCH UPDATE	7/17/16	
	C	DUAL FLOAT SWITCH UPDATE. REMOVAL OF OIL TANK ALARM.	8/6/18	
	D	CR3, CR4 SUBSTITUTION AND PINOUT UPDATE	3/2/20	

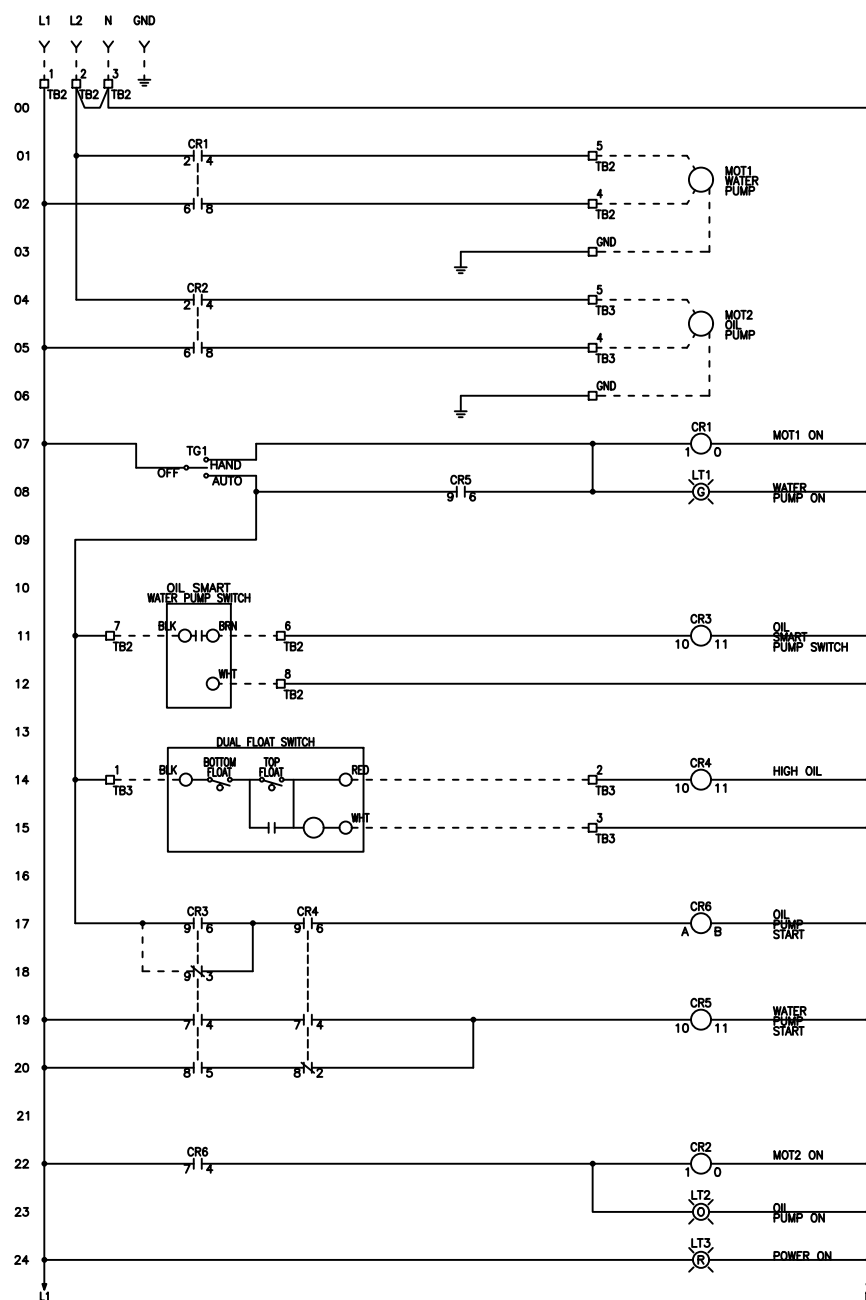

----- DASHED LINE INDICATES FIELD WIRING.

USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE:
60°C (140°F) FOR UNDER 100A.
75°C (167°F) FOR OVER 100A.

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

FIELD WIRING TORQUE SPECS.	
TERMINAL BLOCK UT 2,5	5 IN-LB
TERMINAL BLOCK UT 4	7 IN-LB
TERMINAL BLOCK UT 6	15 IN-LB
TERMINAL BLOCK UT 10	15 IN-LB
TERMINAL BLOCK UT 16	25 IN-LB
TERMINAL BLOCK UT 35	30 IN-LB
TS1, TS2, J2 & J3 PCB	5 IN-LB
TRANSFORMER H1F, H2F & H3F	15 IN-LB
TRANSFORMER H1, H2 & H3	10 IN-LB
M.D. VLS3P16-63 R1	16 IN-LB
M.D. VLS3P63-125 R1	45 IN-LB
M.D. LK4JU3CN 100A	36 IN-LB
M.D. LK4MU3N 200A	200 IN-LB

DRAWN BY: MM
DATE: 4/23/14

APPROVED BY: _____
DATE: _____

THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.

SEEWATER Inc.

TITLE: OSSIM-30-OR-2 CONTROL SCHEMATIC

SIZE B	DWG NO. 1504	PART NO. OSSIM-30-OR-2	REV D
SCALE NONE	SHEET 1 OF 1		